EXHIBIT DPS-GES-2(a)

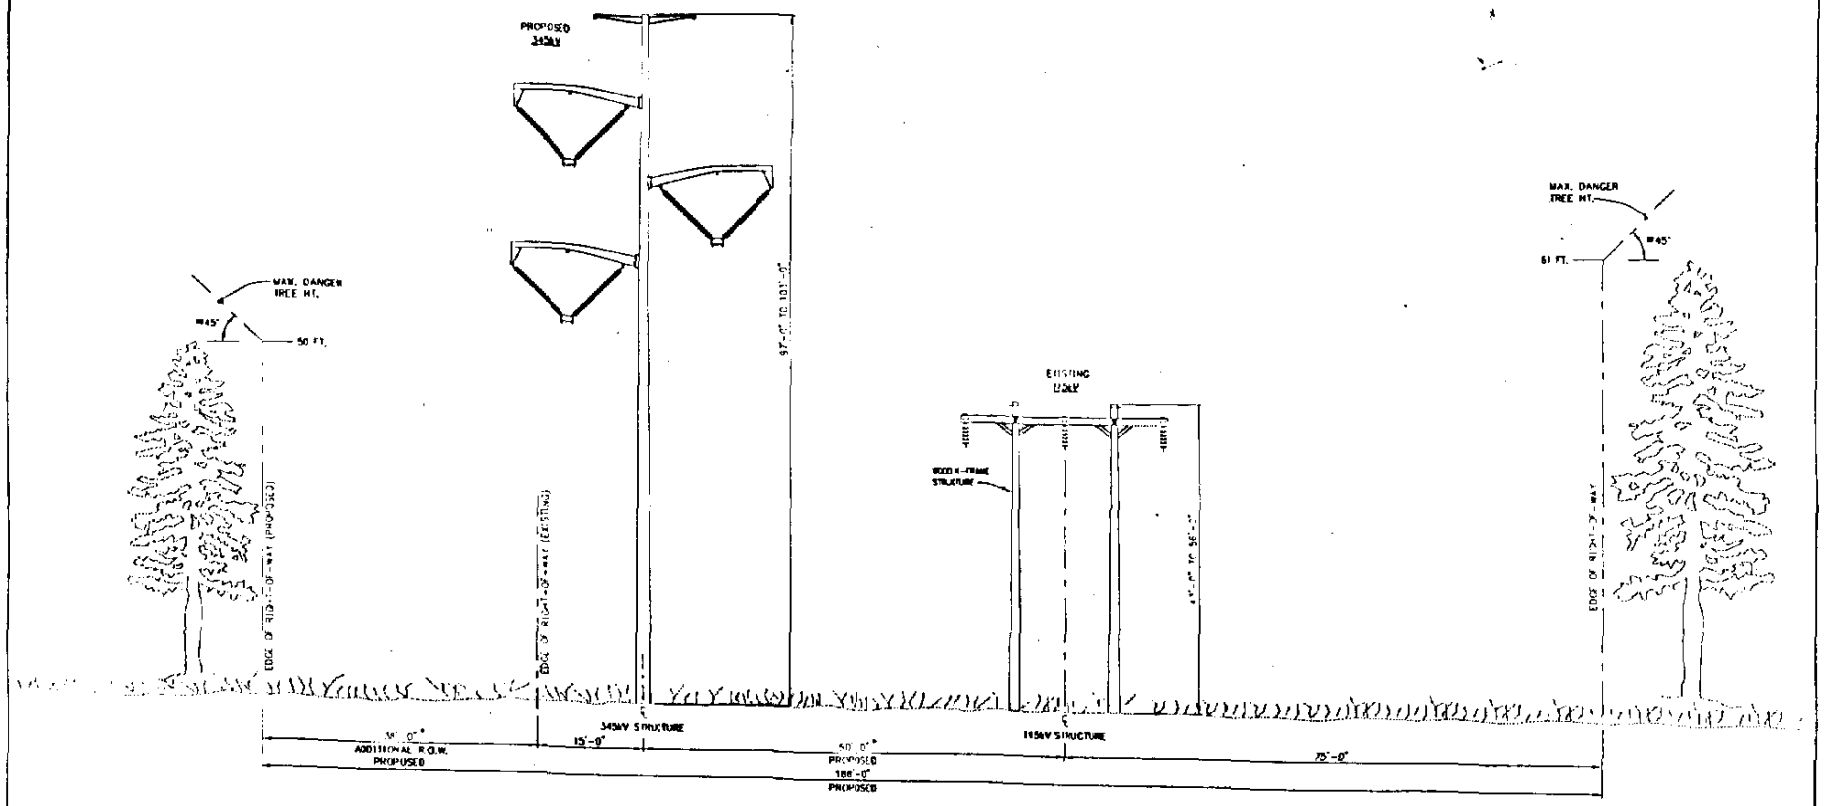

*MIN. REQUIRED DISTANCE

LOOKING NORTH
NEW HAVEN SUBSTATION TO WILLISTON SUBSTATION
IN THE TOWNS OF NEW HAVEN, MONKTON, HINESBURG, ST. GEORGE & WILLISTON
MILE 0.00 TO MILE 21.65
(SPAN LENGTHS 200' TO 800')

REV	DATE	DR	CK	DESCRIPTION

YELCO — VERMONT ELECTRIC POWER CO., INC.
RUTLAND, VERMONT

NEW HAVEN – WILLISTON
345kV LINE
TYPICAL CROSS SECTION
SINGLE CIRCUIT DELTA STEEL

SCALE: NONE	DRAWN BY: DDL	APPROVED BY:	
DATE: 11-03	CHECKED BY: MJM		DATE
DRAWING NUMBER: PLOT: 1:1	DPS2-DJB-4		0 REV.

EXHIBIT DPS-GES-2(b)

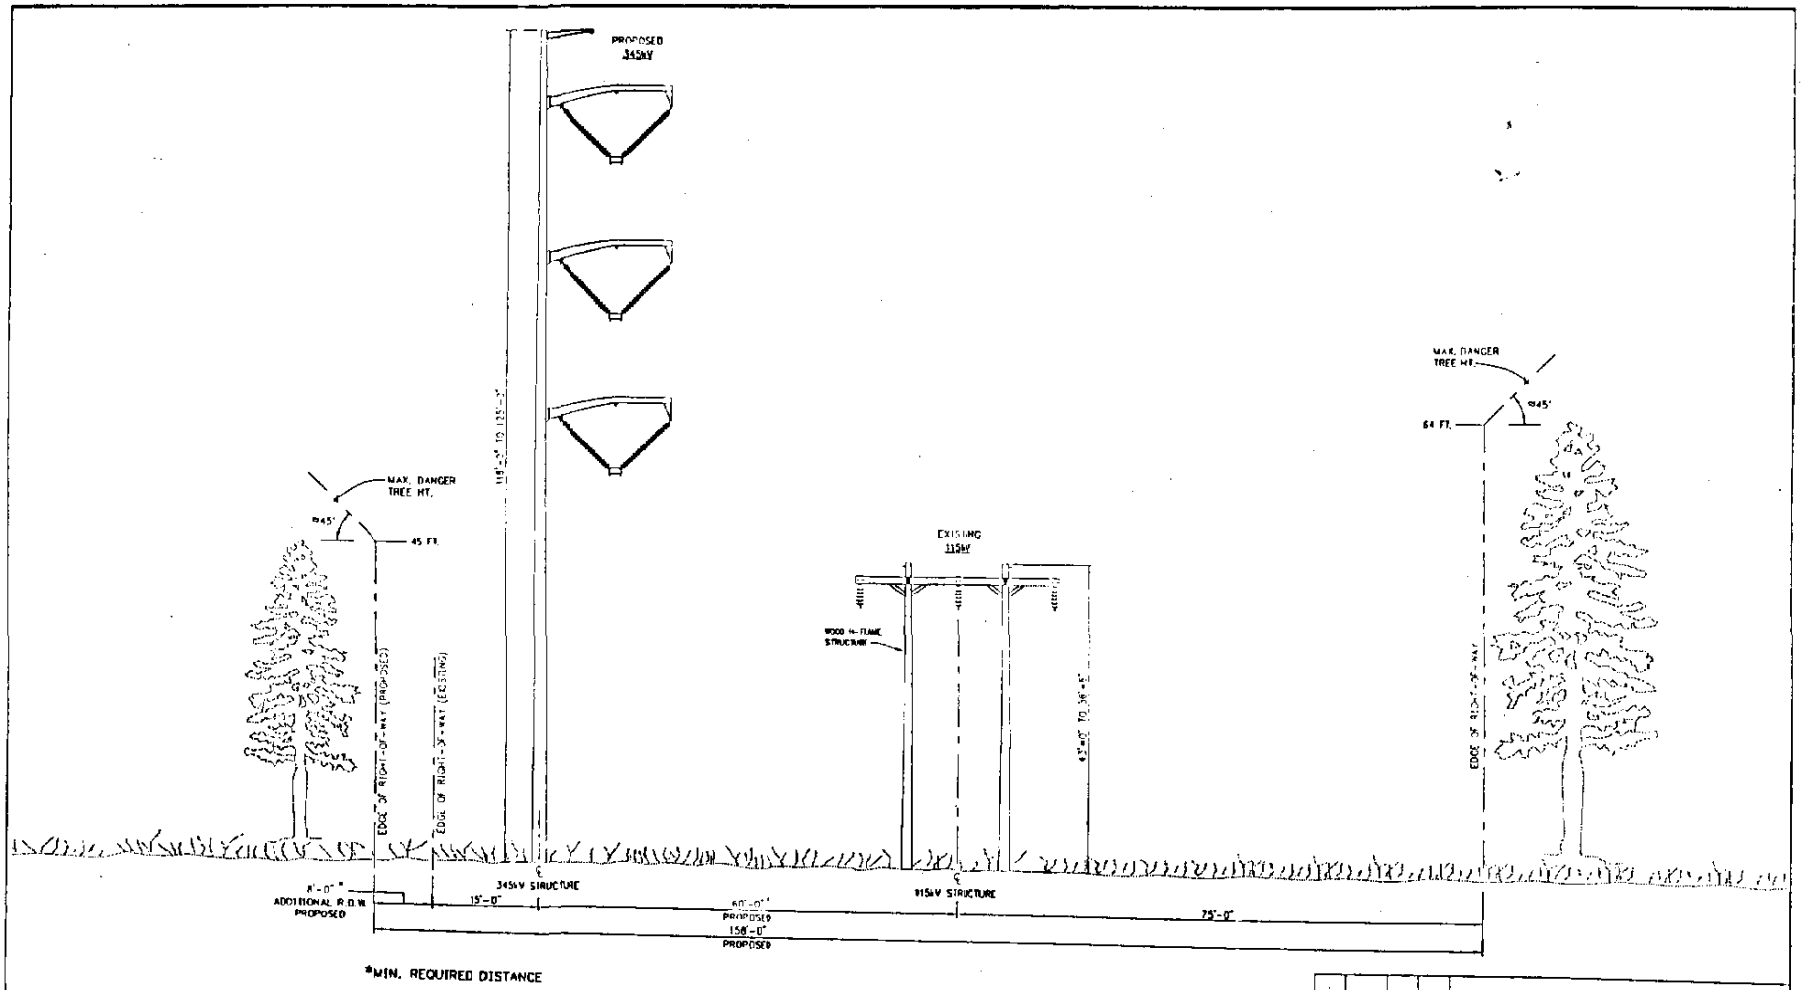

*MIN. REQUIRED DISTANCE

LOOKING NORTH
NEW HAVEN SUBSTATION TO WILLISTON SUBSTATION
IN THE TOWNS OF NEW HAVEN, MONKTON, HINESBURG, ST. GEORGE & WILLISTON
MILE 0.00 TO MILE 21.65
(SPAN LENGTHS 200' TO 800')

REV	DATE	DR	CK	DESCRIPTION

VELCO — VERMONT ELECTRIC POWER CO., INC.
RUTLAND, VERMONT

NEW HAVEN – WILLISTON
345kV LINE
TYPICAL CROSS SECTION
SINGLE CIRCUIT VERTICAL STEEL

SCALE: NONE	DRAWN BY: DDL	APPROVED BY:	
DATE: 11-03	CHECKED BY: MJM		DATE
DRAWING NUMBER: PLOT: 1:1	DPS2-DJB-5		0 REV.

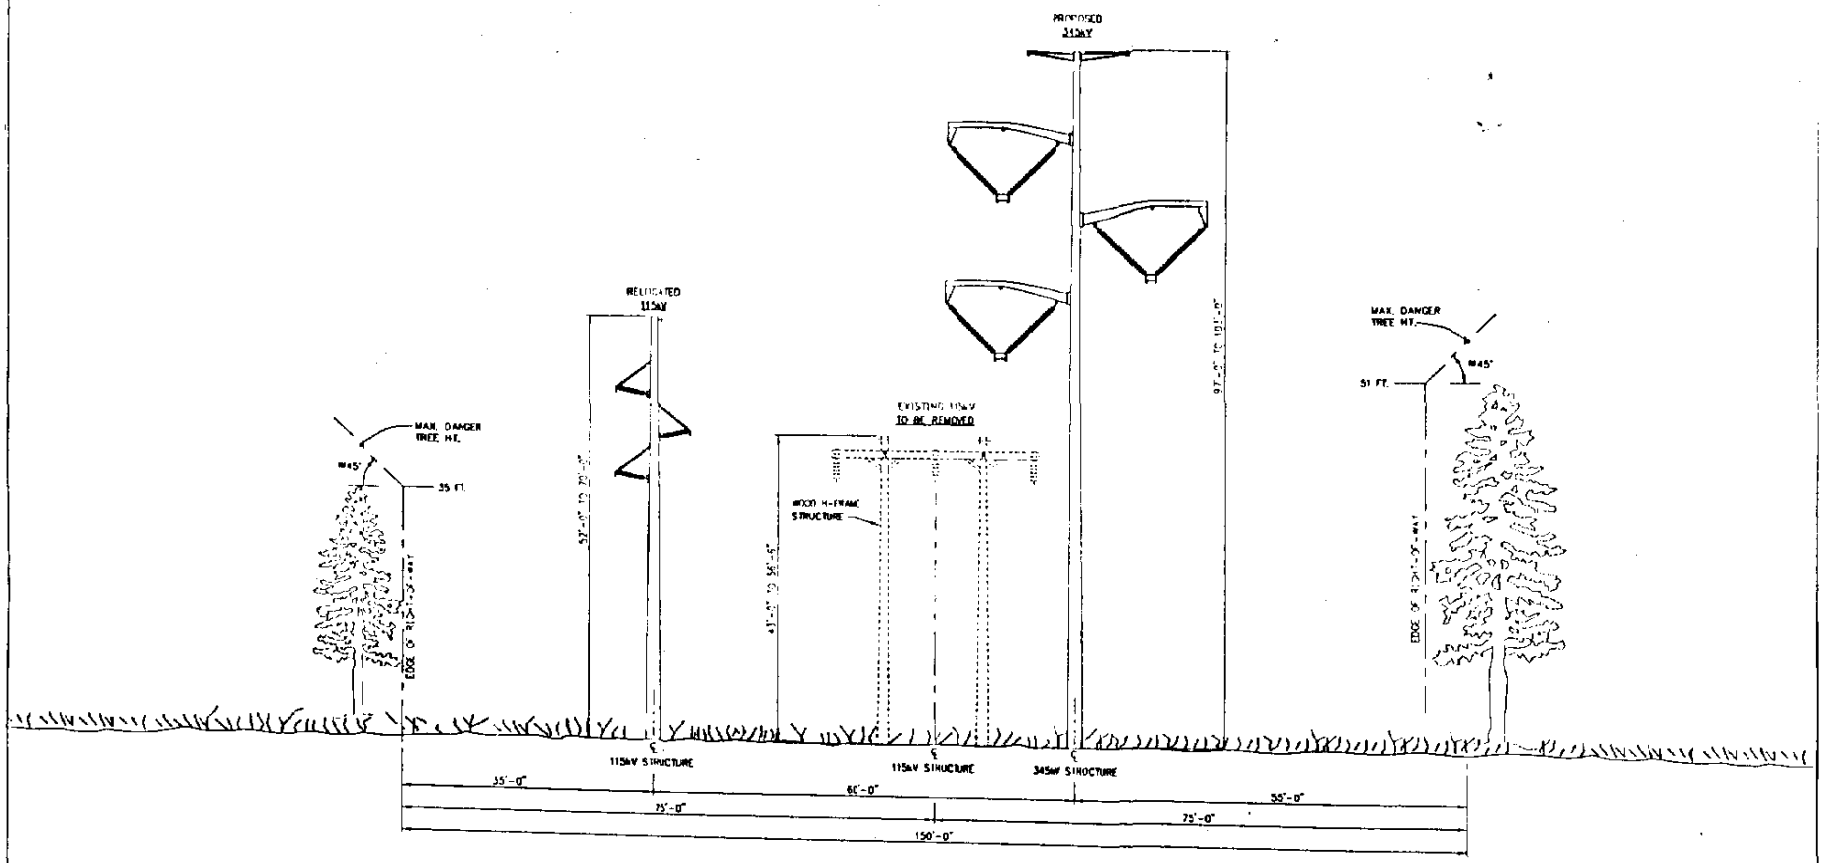

LOOKING NORTH
NEW HAVEN SUBSTATION TO WILLISTON SUBSTATION
IN THE TOWNS OF NEW HAVEN, MONKTON, HINESBURG, ST. GEORGE & WILLISTON
MILE 0.00 TO MILE 21.65
(SPAN LENGTHS 200' TO 800')

REV	DATE	DR	CK	DESCRIPTION

VELCO — VERMONT ELECTRIC POWER CO., INC.
RUTLAND, VERMONT

NEW HAVEN – WILLISTON
345kV LINE
TYPICAL CROSS SECTION
SINGLE CIRCUIT DELTA STEEL

SCALE: NONE	DRAWN BY: DDL	APPROVED BY:	
DATE: 11-03	CHECKED BY: MJM		DATE
DRAWING NUMBER: DPS2-DJB-8	PLOT: 1:1		0 REV.